

AC axial fan

straight blades (A series)

Wall ring with guard grille

ebm-papst Mulfingen GmbH & Co. KG

Bachmühle 2 · D-74673 Mulfingen

Phone +49 7938 81-0

Fax +49 7938 81-110

info1@de.ebmpapst.com

www.ebmpapst.com

Limited partnership · Headquarters Mulfingen

County court Stuttgart · HRA 590344

General partner Elektrobau Mulfingen GmbH · Headquarters Mulfingen

County court Stuttgart · HRB 590142



Nominal data

Type	W2E300-CC47-01		
Motor	M2E068-EC		
Phase		1~	1~
Nominal voltage	VAC	230	230
Frequency	Hz	50	60
Type of data definition		fa	fa
Valid for approval / standard		CE	CE
Speed	min ⁻¹	2650	2900
Power input	W	140	190
Current draw	A	0.62	0.83
Motor capacitor	µF	5	5
Capacitor voltage	VDB	400	400
Max. back pressure	Pa	150	150
Min. ambient temperature	°C	-25	-25
Max. ambient temperature	°C	55	50

ml = max. load · me = max. efficiency · fa = running at free air · cs = customer specs · cu = customer unit
Subject to alterations

Data according to ErP directive

Installation category	A
Efficiency category	Static
Variable speed drive	No
Specific ratio*	1.00

* Specific ratio = $1 + p_{fs} / 100\,000\text{ Pa}$

	Actual	Request 2013	Request 2015
Overall efficiency η_{es}	28.7	24.6	28.6
Efficiency grade N	40.1	36	40
Power input P_e	kW	0.16	
Air flow q_v	m ³ /h	1650	
Pressure increase p_{fs}	Pa	100	
Speed n	min ⁻¹	2565	

Data established at point of optimum efficiency



AC axial fan

straight blades (A series)

Wall ring with guard grille


Technical features

Mass	4.6 kg
Size	300 mm
Surface of rotor	Coated in black
Material of impeller	Sheet steel, coated in black
Material of wall ring	Sheet steel, pre-galvanised and coated in black plastic (RAL 9005)
Material of guard grille	Steel, coated in black plastic (RAL9005)
Number of blades	5
Direction of air flow	"V"
Direction of rotation	Counter-clockwise, seen on rotor
Type of protection	IP 44; Depending on installation and position as per EN 60034-5
Insulation class	"B"
Humidity class	F1-2
Max. permissible ambient motor temp. (transp./ storage)	+ 80 °C
Min. permissible ambient motor temp. (transp./storage)	- 40 °C
Mounting position	Shaft horizontal or rotor on bottom; rotor on top on request
Condensate discharge holes	Rotor-side
Operation mode	S1
Motor bearing	Ball bearing
Touch current acc. IEC 60990 (measuring network Fig. 4, TN system)	< 0.75 mA
Motor protection	Thermal overload protector (TOP) wired internally
Cable exit	Variable
Protection class	I (if protective earth is connected by customer)
Product conforming to standard	EN 60335-1; CE
Approval	CCC




AC axial fan
straight blades (A series)
Wall ring with guard grille

Product drawing

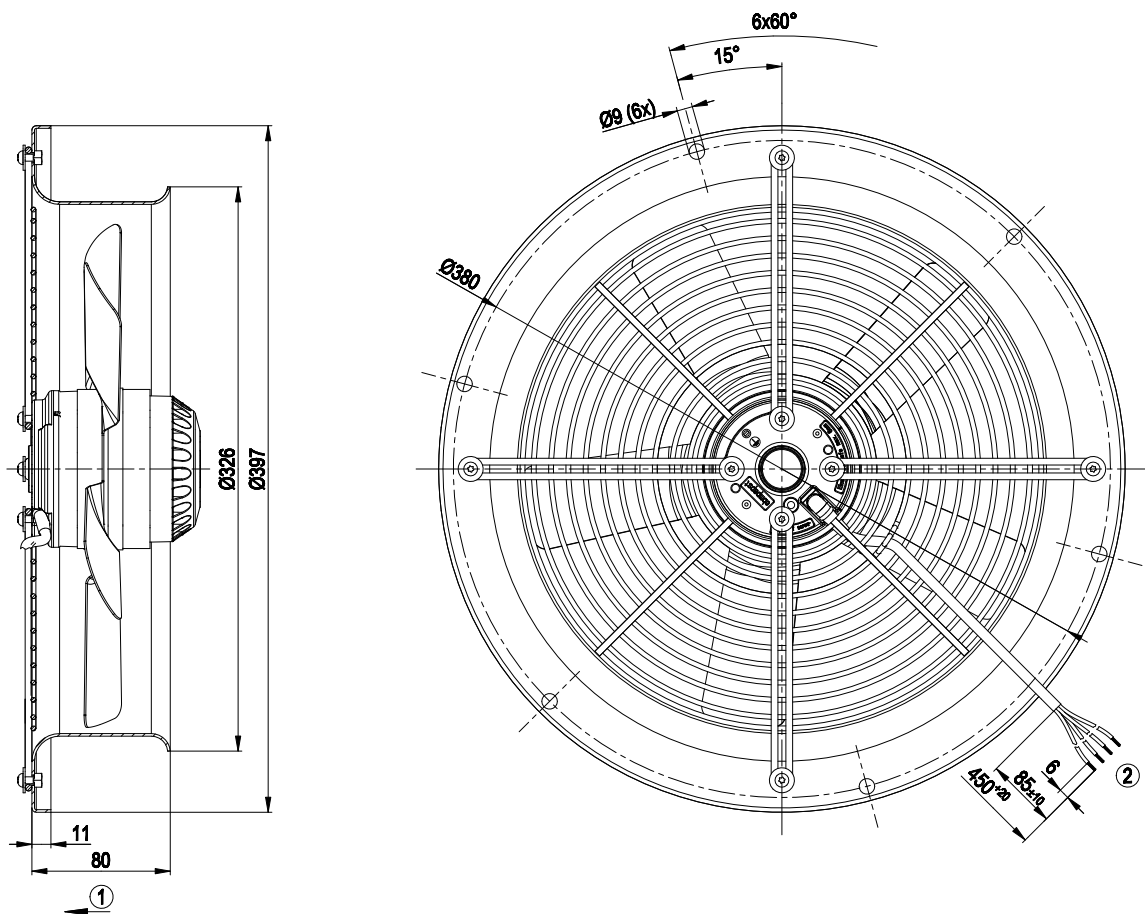

- | | |
|---|--|
| 1 | Direction of air flow "V" |
| 2 | Connection line PVC 4G 0.5 mm², 4x brass lead tips crimped |

Connection screen

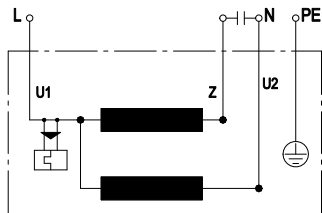


U1	blue	Z	brown	U2	black
PE	green/yellow				



AC axial fan

straight blades (A series)
Wall ring with guard grille

Charts: Air flow 50 Hz

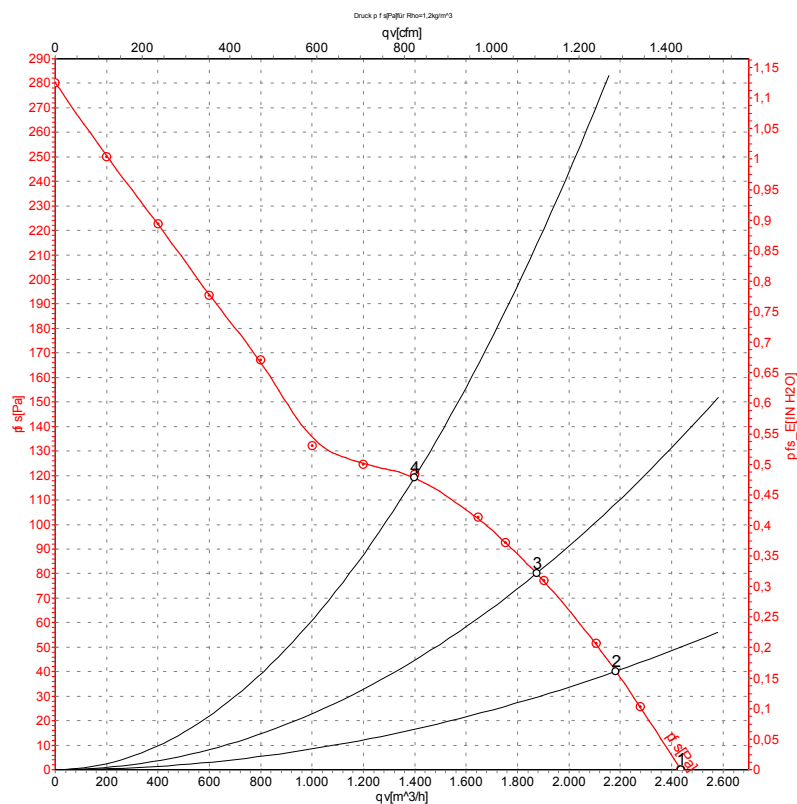

Measurement: LU-66600

Air performance measured as per ISO 5801
Installation category A. For detailed
information on the measuring set-up, please
contact ebm-papst. Suction-side noise
levels: L_{WA} measured as per ISO 13347 /
L_{pA} measured with 1m distance to fan axis.
The values given are valid under the
measuring conditions mentioned above and
may vary according to the actual installation
situation. With any deviation from the
standard set-up, the specific values have to
be checked and reviewed with the unit
installed.

Measured values


	U	f	n	P _e	I	qv	p _{fs}
	V	Hz	min ⁻¹	W	A	m³/h	Pa
1	230	50	2650	140	0.62	2435	0
2	230	50	2615	151	0.66	2185	40
3	230	50	2580	158	0.69	1875	80
4	230	50	2560	162	0.71	1400	120

U = Supply voltage · f = Frequency · n = Speed · P_e = Power input · I = Current draw · qv = Air flow · p_{fs} = Pressure increase



AC axial fan
straight blades (A series)
Wall ring with guard grille

Charts: Air flow 60 Hz

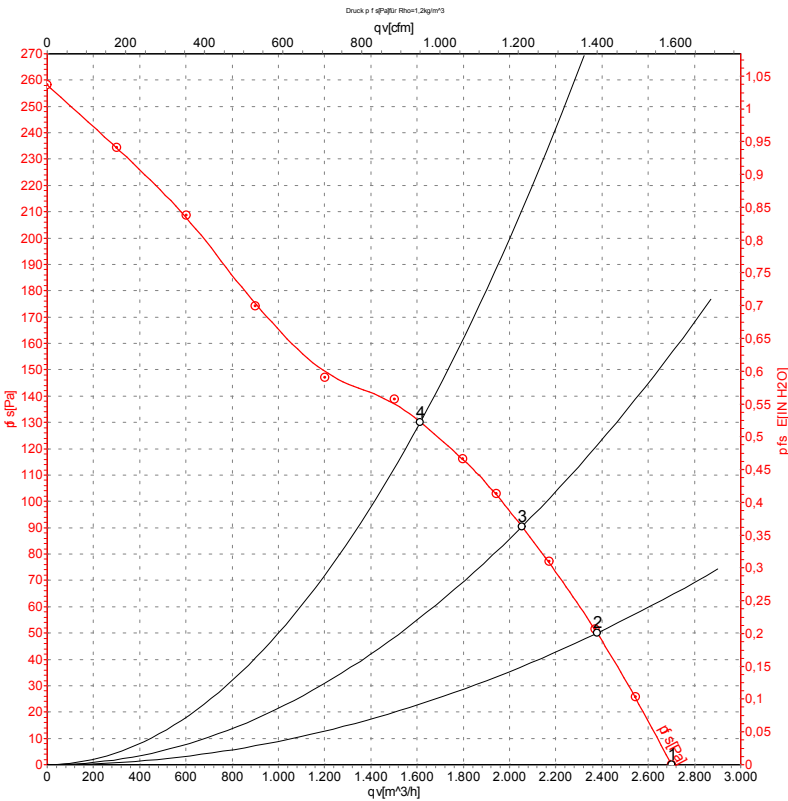

Measurement: LU-66601

Air performance measured as per ISO 5801
Installation category A. For detailed
information on the measuring set-up, please
contact ebm-papst. Suction-side noise
levels: L_{WA} measured as per ISO 13347 /
L_{pA} measured with 1m distance to fan axis.
The values given are valid under the
measuring conditions mentioned above and
may vary according to the actual installation
situation. With any deviation from the
standard set-up, the specific values have to
be checked and reviewed with the unit
installed.

Measured values

	U	f	n	P _e	I	qv	p _{fs}
	V	Hz	min ⁻¹	W	A	m³/h	Pa
1	230	60	2900	190	0.83	2700	0
2	230	60	2865	205	0.90	2380	50
3	230	60	2805	213	0.93	2055	90
4	230	60	2755	218	0.95	1615	130

U = Supply voltage · f = Frequency · n = Speed · P_e = Power input · I = Current draw · qv = Air flow · p_{fs} = Pressure increase

